


- SOUTHERN RIVERS ENERGY FURNISHES THE METER BASE, METER, CTs, CT WIRES AND MAKES THE CONNECTIONS IN THE CT CAN.
- CONSUMER/ELECTRICIAN PROVIDES AND INSTALLS CT CAN AND MAIN DISCONNECT, INSTALLS METER BASE AND 1" NIPPLE, INSTALLS SERVICE WIRE FROM CT CAN INTO DISCONNECT AND MAKES UP DISCONNECT.
- CT CAN MUST BE MINIMUM OF 30" X 36" X 12" DEEP.
- CT CAN MUST BE WEATHERTIGHT AND HAVE LOCKING MECHANISM. SRE WILL CONTROL THE KEY TO THE CT CAN LOCK.
- CT CAN, METERBASE AND MAIN DISCONNECT MUST BE MOUNTED ON AN EXTERIOR WALL.

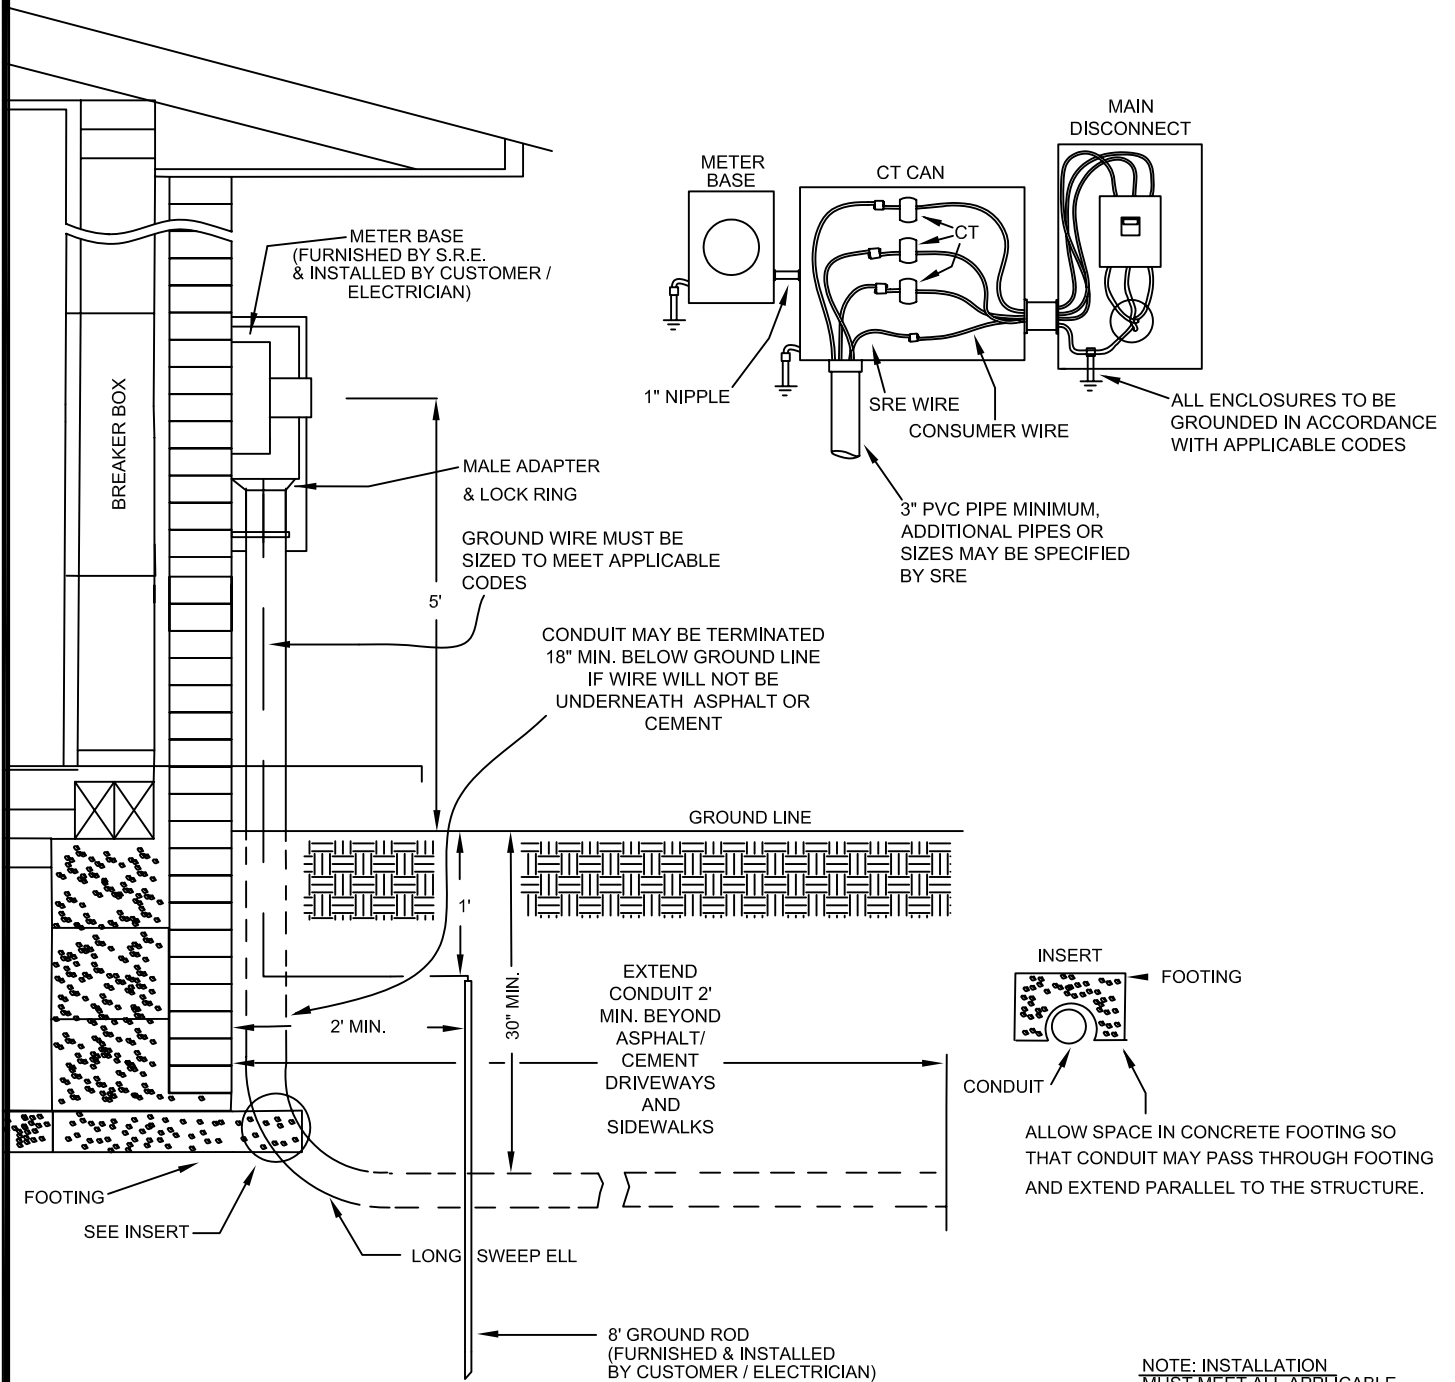

NOTE: INSTALLATION  
MUST MEET ALL APPLICABLE  
CODES.